

Sikacryl 621 Fire+

PRESTANDADECLARATION No. 79744211

1	PRODUKTTYPENS UNIKA IDENTIFIKATIONSKOD:	79744211
2	AVSEDD ANVÄNDNING/ AVSEDDA ANVÄNDNINGAR:	EAD 350141-00-1106:2017 Fire Stopping and Sealing Product: Linear Joint and Gap Seals
3	TILLVERKARE:	Sika Services AG Tüffenwies 16-22 8064 Zürich
4	TILLVERKARENS REPRESENTANT:	
5	SYSTEM FÖR BEDÖMNING OCH FORTLÖPANDE KONTROLL AV PRESTANDA:	System 1
6b	EUROPEISKT BEDÖMNINGSDOKUMENT:	EAD 350141-00-1106:2017
	Europeisk teknisk bedömning:	ETA-21/0889 of 2021/10/20
	Tekniskt bedömningsorgan:	DBI Certification A/S
	Notified body/ies:	2531

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

7 DECLARED PERFORMANCE/S

Essential Characteristics	Performance	AVCP	Harmonised Technical Specification
Reaction to fire	D – s1, d1	System 1	EAD 350141-00- 1106:2017
Resistance to fire	Annex A	System 1	
Content, emission and/or release of dangerous substances	No performance assessed	System 1	
Water permeability	No performance assessed	System 1	
Release of dangerous substances	No performance assessed	System 1	
Mechanical resistance and stability	No performance assessed	System 1	
Resistance to impact/movement	No performance assessed	System 1	
Adhesion	No performance assessed	System 1	
Durability	Z2	System 1	
Movement capacity	No performance assessed		
Cycling of perimeter seals for curtain walls	No performance assessed		
Compression set	No performance assessed		
Linear expansion on setting	No performance assessed		
Airborne sound insulation	Rw(C;Ctr)= 62 (-1;-5) dB*	System 1	
Thermal properties	No performance assessed	System 1	
Water vapour permeability	No performance assessed	System 1	

* At 12 mm depth

A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side


A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, joint widths up to 30 mm	
Construction details:	

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

2/27

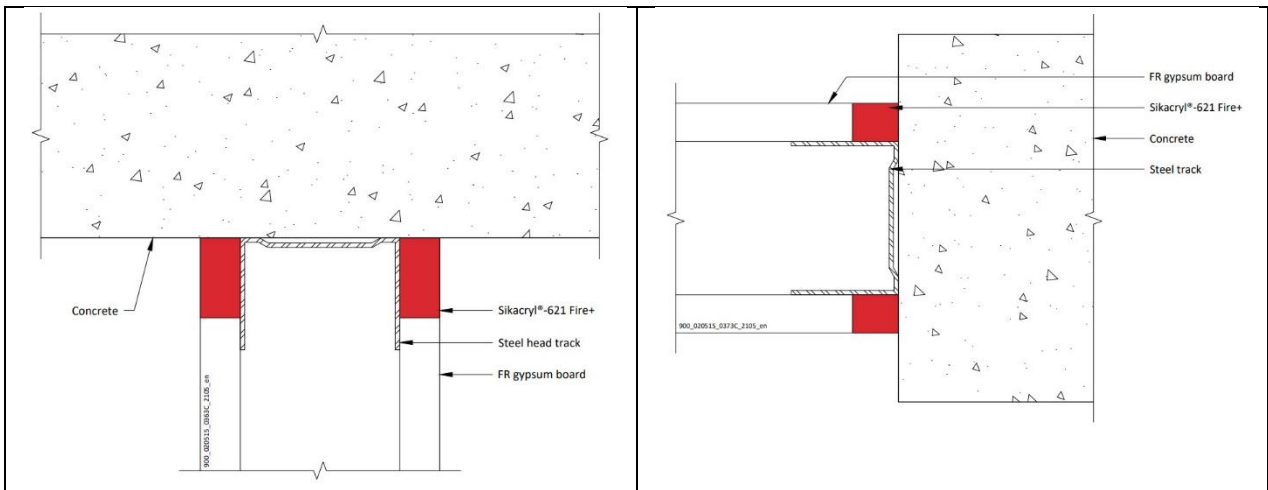

A.1.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
Plasterboard/ concrete	12.5 min.	50 mm steel partition head track/ stud	E 60 – T – X – F – W 25 EI 45 – T – X – F – W 25
			E 60 – V – X – F – W 15 EI 45 – V – X – F – W 15

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


3/27

A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side

A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, joint widths up to 30 mm

Construction details:

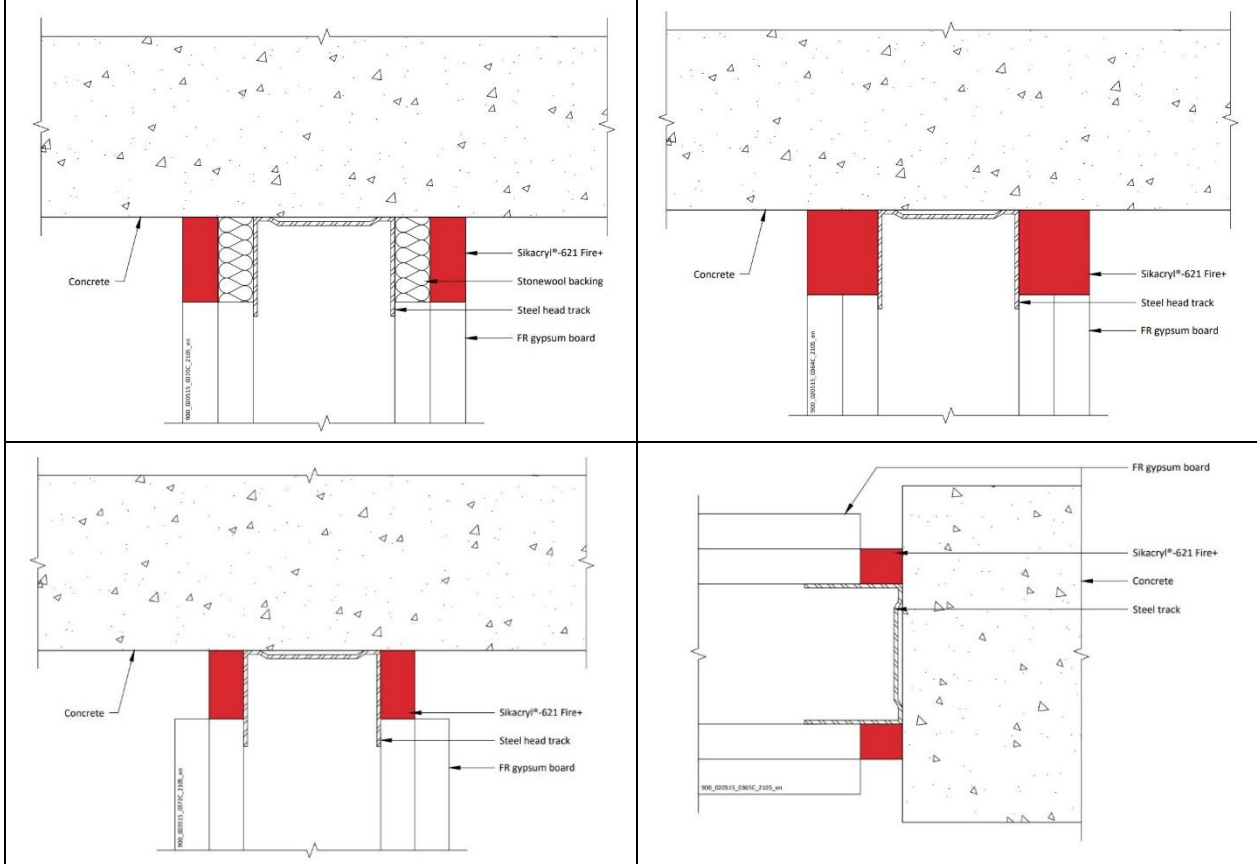

A.2.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
Plasterboard/ concrete	12.5 min.	12.5 mm Stone wool 35 kg/m³ plus 50 mm steel partition head track	EI 120 – T – X – F – W 30
		20 mm Stone wool 35 kg/m³	EI 120 – V – X – F – W 30
	25 min.	50 mm steel partition head track /stud	EI 120 – T – X – F – W 30
	12.5 min.		EI 90 – T – X – F – W 25
			EI 90 – V – X – F – W 15

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


4/27

A.2.2 Flexible or rigid wall construction with wall thickness of minimum 100 mm and timber substrates and architraves

A.2.2.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to one side of the wall, joint widths up to 30 mm

Construction details:

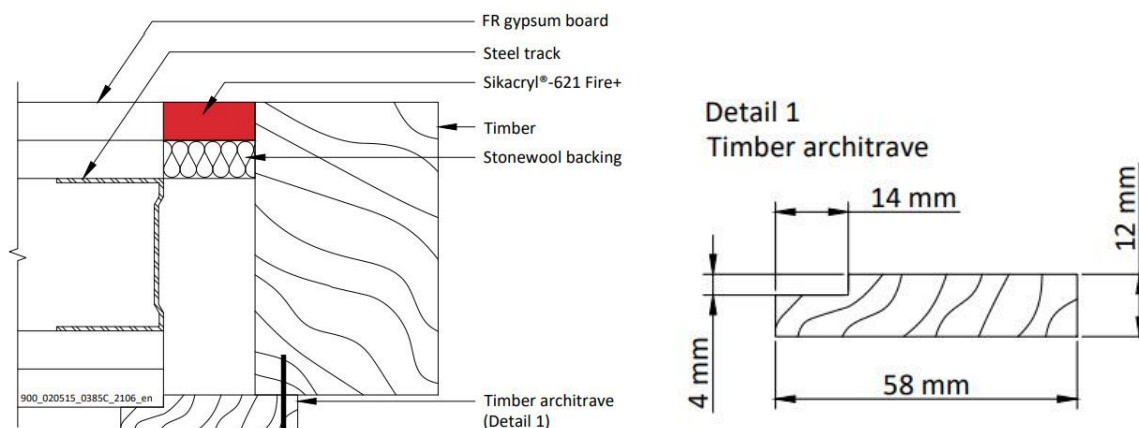

A.2.2.2


Substrate	Depth (mm)	Facing (minimum)	Backing	Classification
Flexible or rigid wall / Timber	12.5 min.	Single sided linear seals in flexible or rigid walls against wooden frames covered with architraves on the other side fixed with 25 mm steel pins at nominal 300 mm centres.	Stonewool, 12.5 mm deep min. 35 kg/m ³	EI 60 – V – X – F – W 30
				EI 60 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

A.2.3 Flexible or rigid wall construction with wall thickness of minimum 100 mm and timber substrates

A.2.3.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

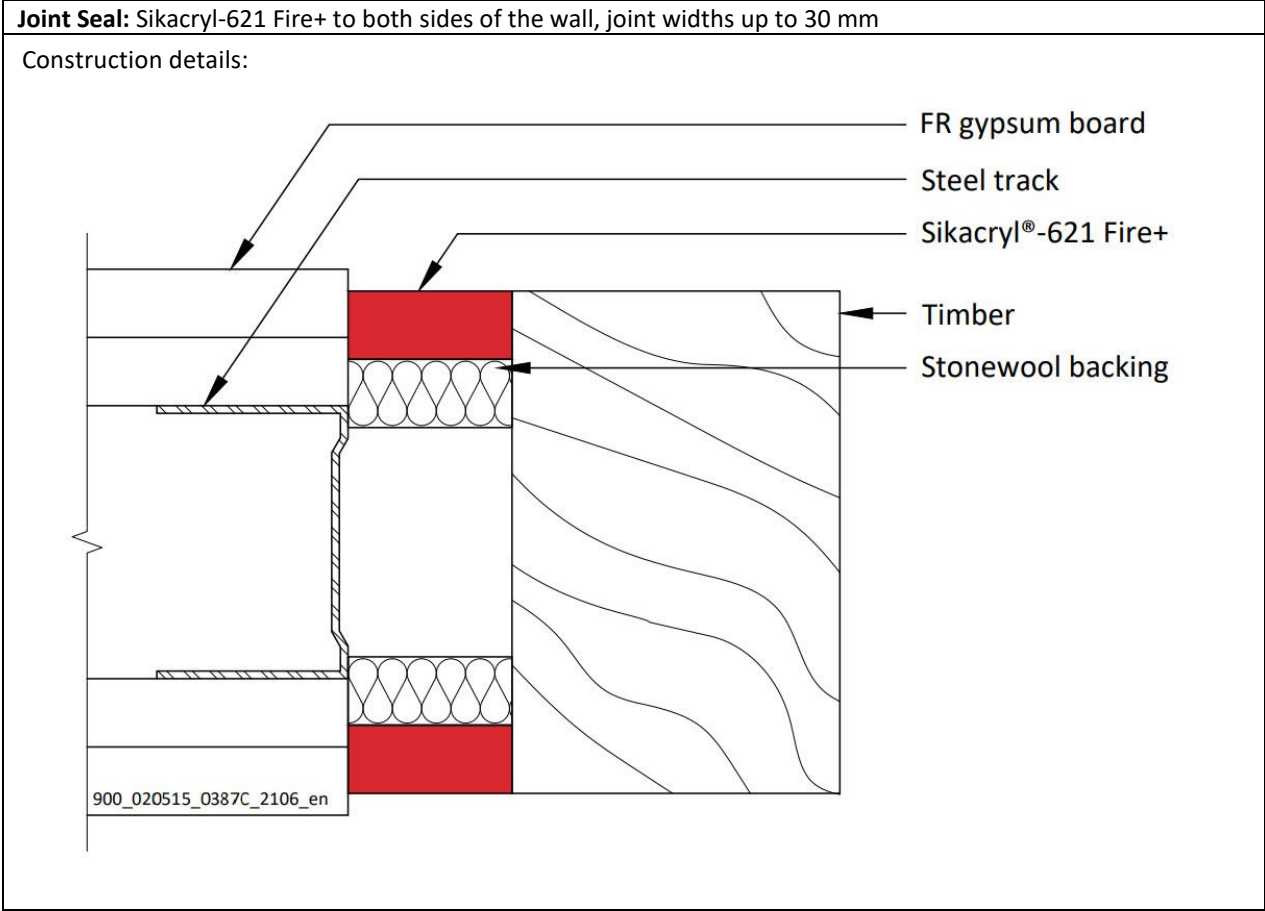

A.2.3.2

Substrate	Depth (mm)	Backing	Classification
Flexible or rigid wall / Timber	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m³	E 90 – V – X – F – W 30
			EI 60 – V – X – F – W 30
			E 90 – T – X – F – W 30
			EI 60 – T – X – F – W 30

Declaration of Performance


Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

A.2.4 Flexible or rigid wall construction with wall thickness of minimum 100 mm and steel substrates

A.2.4.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to one side of the wall, with joint widths up to 30 mm.

Construction details:

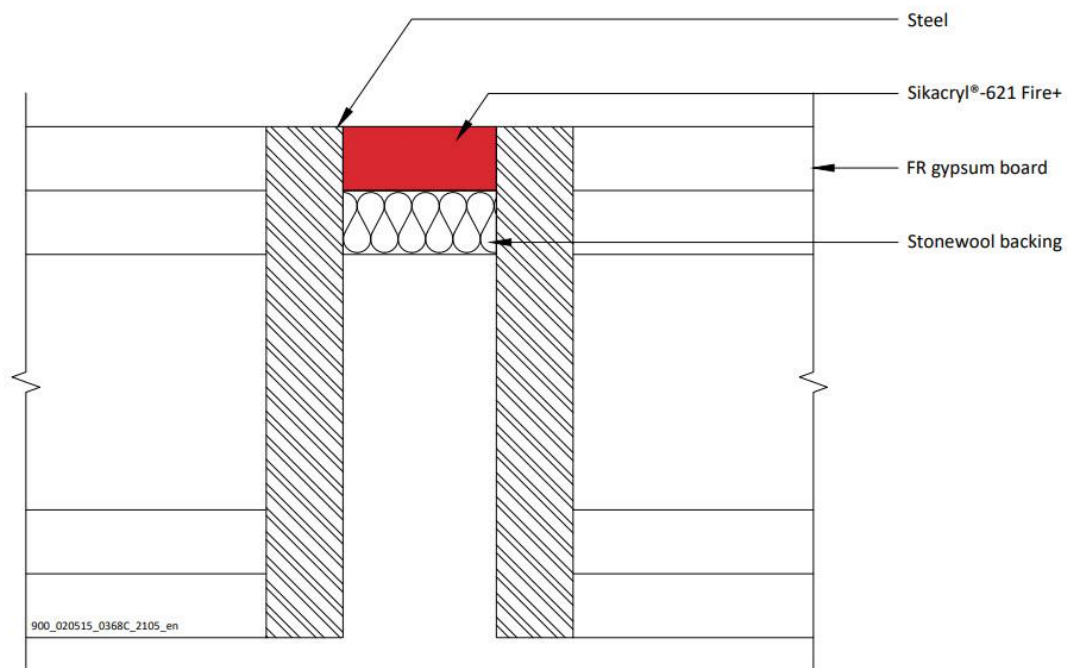

A.2.4.2

Substrate	Depth (mm)	Backing	Classification
Steel / steel	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m ³	E 120 – V – X – F – W 30
			EI 30 – V – X – F – W 30
			E 120 – T – X – F – W 30
			EI 30 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1


1549

7/27

A.2.5 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, with joint widths up to 30 mm.

Construction details:

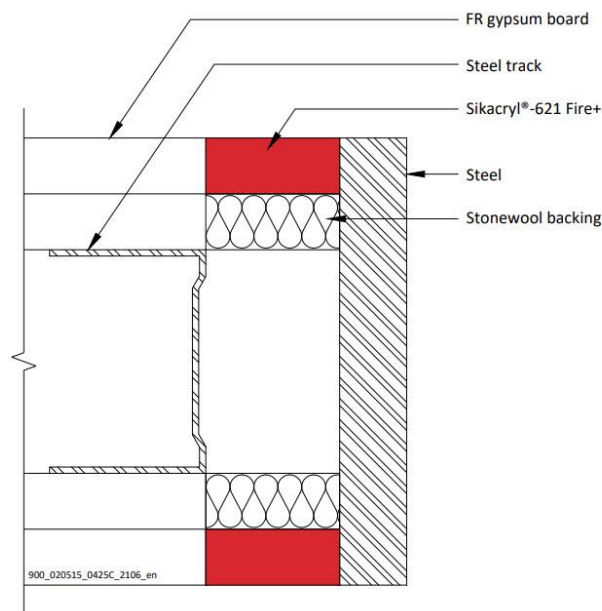

A.2.5.1

Substrate	Depth (mm)	Backing	Classification
Flexible or rigid wall / Steel	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m ³	E 120 – V – X – F – W 30 ¹ EI 30 – V – X – F – W 30 ²
			E 120 – T – X – F – W 30 ³ EI 45 – T – X – F – W 30 ⁴

*Additional and for information only.

The classifications provided in Table A.2.5.1 consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

¹ 120, ² 90, ³ 120, ⁴ 60

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549




8/27

A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm

A.3.1 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls

Joint Seal: Sikacryl-621 Fire+ to either side (or any position between) or both sides of the wall, joint widths up to 30 mm

Construction details:

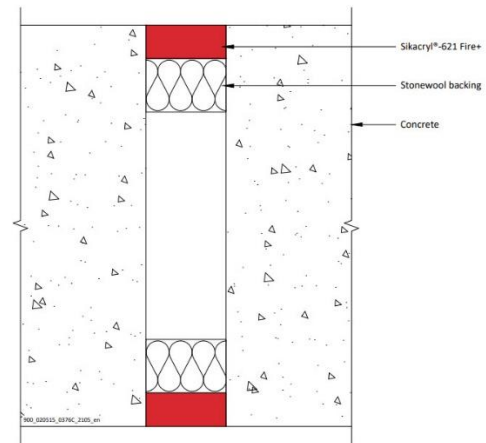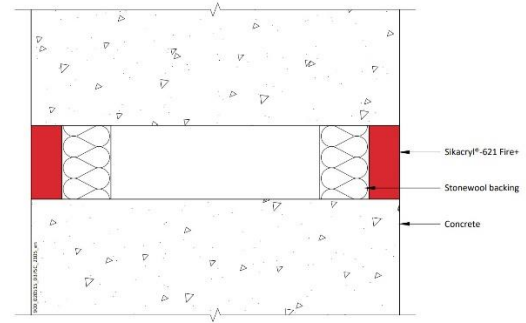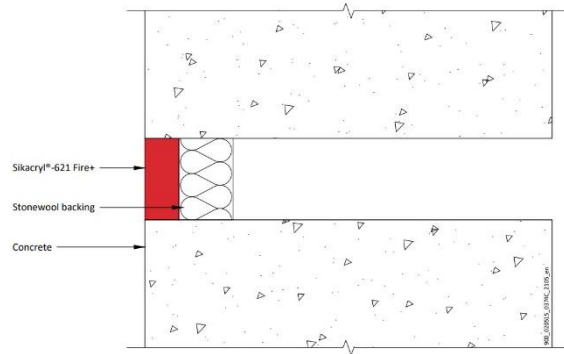

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549

9/27

A.3.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
masonry/ concrete	25 min. (one side)	20 mm Stone wool 40 kg/m ³	E 240 – T – X – F – W 30 EI 60 – T – X – F – W 30
	15 min. (both sides)		EI 240 – V – X – F – W 30 EI 240 – T – X – F – W 30
	10 min. (one side)	60 mm Stone wool 33 kg/m ³	E 240 – T – X – F – W 50 EI 60 – T – X – F – W 50 EI 120 – V – X – F – W 50
	25 min. (one side)	48 mm AES mineral fibre	E 240 – T – X – F – W 30 EI 120 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


10/27

A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm

A.4.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to the top face of the floor only

Joint Seal: Sikacryl-621 Fire+ to either side (or any position between) or both sides of the floor, joint widths up to 100 mm

Construction details:

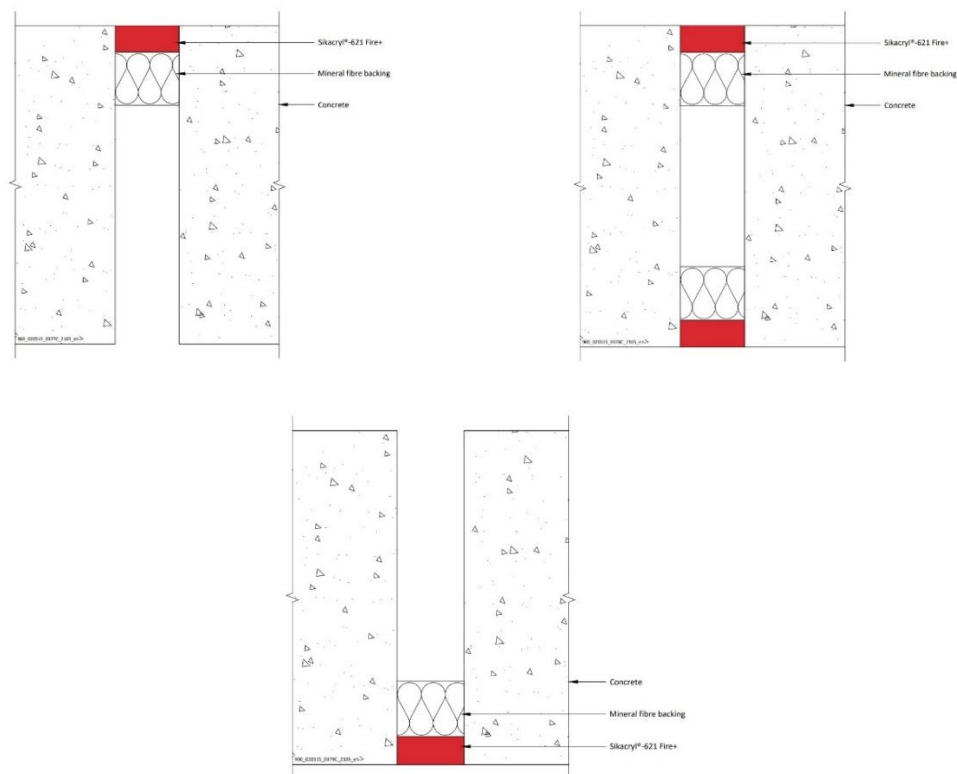

A.4.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
masonry/ concrete	25 min. (any position)	25 mm AES mineral fibre	E 120 – H – X – F – W 100
	25 min (top face)		EI 60 – H – X – F – W 100
	15 min. (both sides)	25 mm Stone wool 40 kg/m ³	EI 180 – H – X – F – W 100
		25 mm Stone wool 140 kg/m ³	EI 120 – H – X – F – W 100
	15 min. (both sides)	25 mm stone wool 35 kg/m ³ insulation	EI 180 – H – X – F – W 100
	10 min. (top face)	90 mm Stone wool 33 kg/m ³	EI 240 – H – X – F – W 30
			EI 240 – H – X – F – W 100

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1


1549

11/27

A.4.2 Linear joint or gap seals, in or between rigid floors

Joint Seal: Sikacryl-621 Fire+ in floor, joint widths up to 30 mm

Construction details:

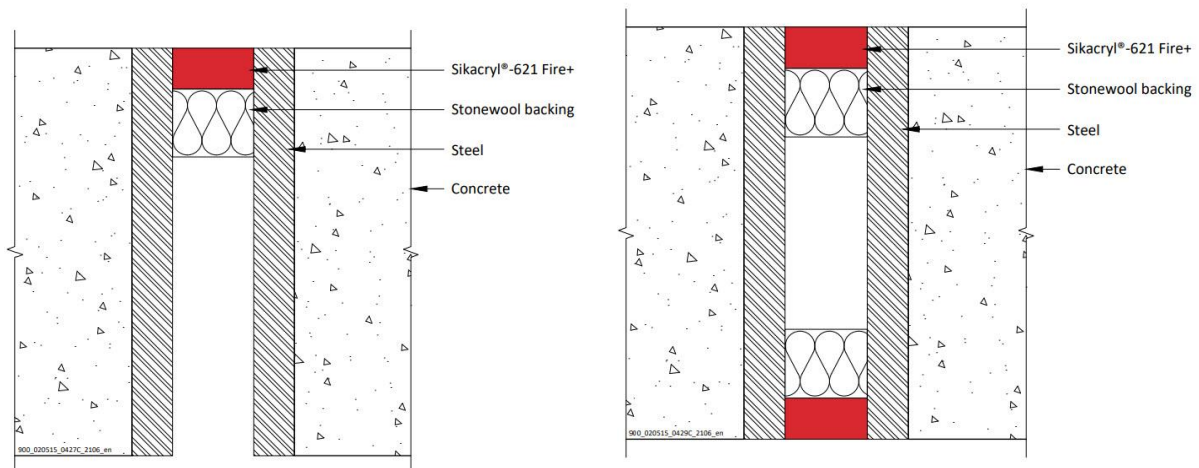

A.4.2.1

Substrate	Depth (mm)	Backing	Position	Classification
Steel/ steel or Steel/ concrete	25 min.	Stonewool, 50 mm deep min. 35 kg/m ³	Top	E 240 – H – X – F – W 30 ¹ EI 30 – H – X – F – W 30 ²
	15 min.	Stonewool, 25 mm deep min. 35 kg/m ³	Both	E 240 – H – X – F – W 30 ³ EI 45 – H – X – F – W 30 ⁴
Aluminium / concrete	25 min.	Stonewool, 50 mm deep min. 35 kg/m ³	Top	E 180 – H – X – F – W 30 ⁵ EI 20 – H – X – F – W 30 ⁶

*Additional and for information only.

The classifications provided in Table A.4.2.1 consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

¹ 240, ² 60, ³ 240, ⁴ 120, ⁵ 180, ⁶ 60

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549

12/27

**8 LÄMPLIG TEKNISK DOKUMENTATION OCH/ELLER
SÄRSKILD TEKNISK DOKUMENTATION**

Prestandan för ovanstående produkt överensstämmer med den angivna prestandan.
Denna prestandadeklaration har utfärdats i enlighet med förordning (EU) nr 05/2011
på eget ansvar av den tillverkare som anges ovan.

Undertecknad på tillverkarens vägnar av:

Namn: Daniel Jonsson
Funktion: VD
Spånga den 22 januari 2025



Namn: Jörgen Backman
Funktion: Produktchef
Spånga den 22 januari 2025



Slut på information som krävs enligt förordning (EU) nr. 305/2011

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

13/27

FULL CE MARKING

CE 21	
Sika Services AG, Zurich, Switzerland	
DoP No. 79744211	
Reaction to fire	D – s1, d1
Resistance to fire	Annex A
Durability	Z2
Airborne sound insulation	Rw(C;Ctr)= 62 (-1;-5) dB*

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

Annex A – Resistance to Fire Classification – Sikacryl-621 Fire+Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side

A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, joint widths up to 30 mm

Construction details:

A.1.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
Plasterboard/ concrete	12.5 min.	50 mm steel partition head track/ stud	E 60 – T – X – F – W 25 EI 45 – T – X – F – W 25
			E 60 – V – X – F – W 15 EI 45 – V – X – F – W 15

Declaration of Performance


Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side

A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, joint widths up to 30 mm

Construction details:

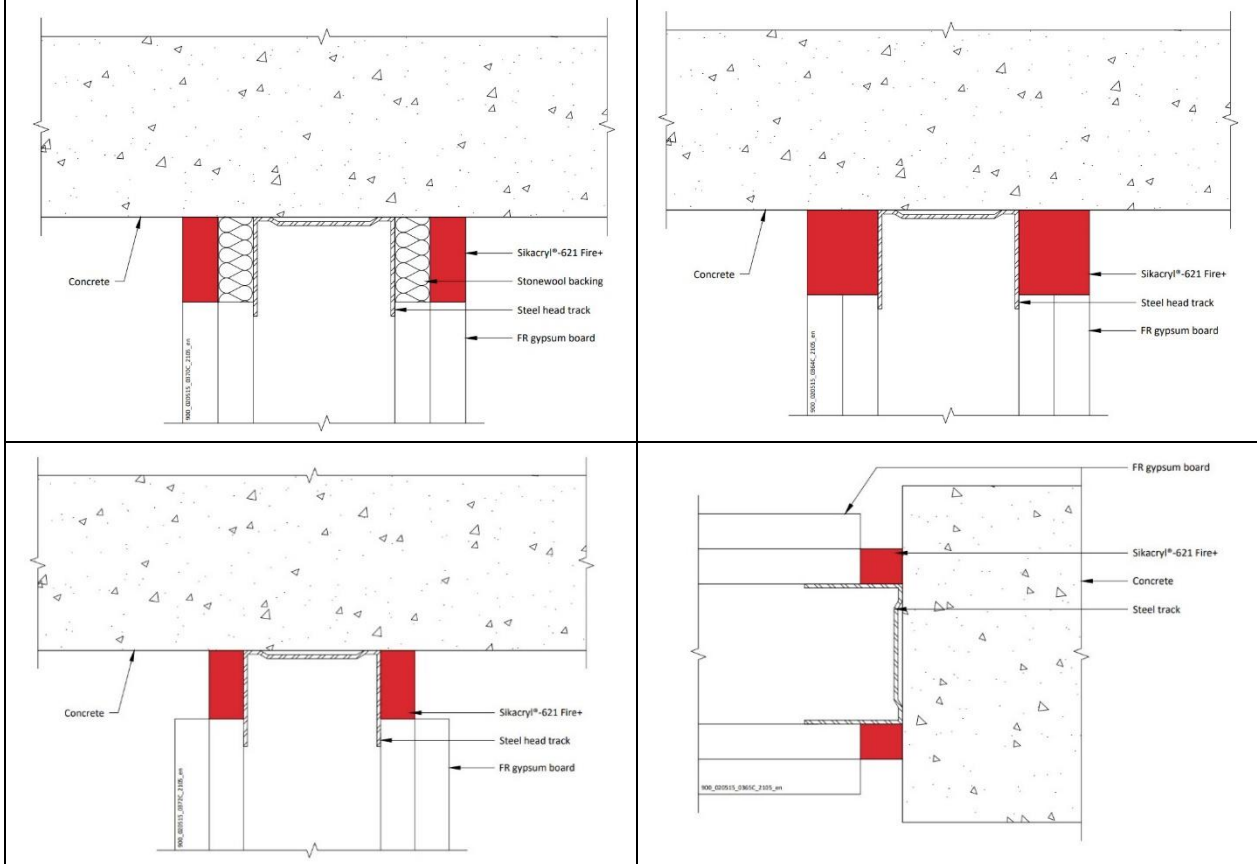

A.2.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
Plasterboard/ concrete	12.5 min.	12.5 mm Stone wool 35 kg/m³ plus 50 mm steel partition head track	EI 120 – T – X – F – W 30
		20 mm Stone wool 35 kg/m³	EI 120 – V – X – F – W 30
	25 min.	50 mm steel partition head track /stud	EI 120 – T – X – F – W 30
	12.5 min.		EI 90 – T – X – F – W 25
			EI 90 – V – X – F – W 15

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


16/27

A.2.2 Flexible or rigid wall construction with wall thickness of minimum 100 mm and timber substrates and architraves

B.2.2.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to one side of the wall, joint widths up to 30 mm

Construction details:

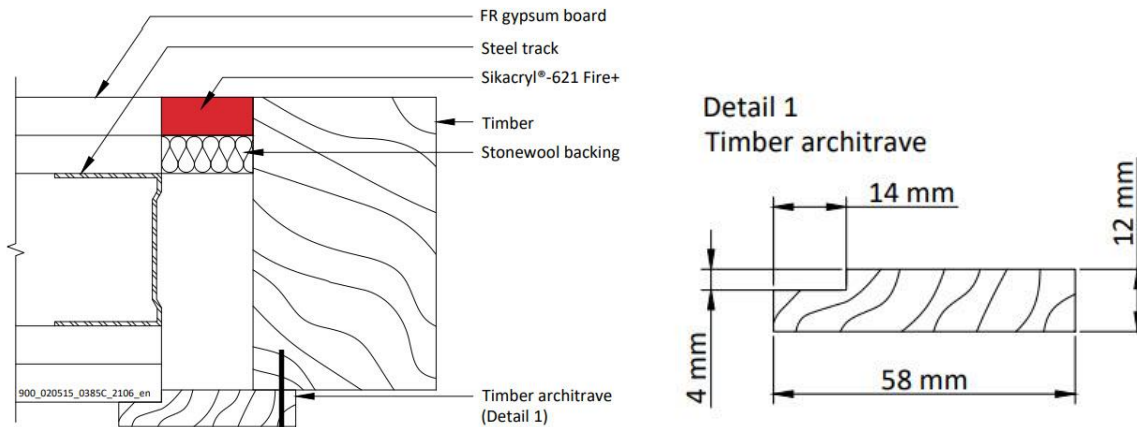

B.2.2.2

Substrate	Depth (mm)	Facing (minimum)	Backing	Classification
Flexible or rigid wall / Timber	12.5 min.	Single sided linear seals in flexible or rigid walls against wooden frames covered with architraves on the other side fixed with 25 mm steel pins at nominal 300 mm centres.	Stonewool, 12.5 mm deep min. 35 kg/m ³	EI 60 – V – X – F – W 30
				EI 60 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549


17/27

A.2.3 Flexible or rigid wall construction with wall thickness of minimum 100 mm and timber substrates

B.2.3.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, joint widths up to 30 mm

Construction details:

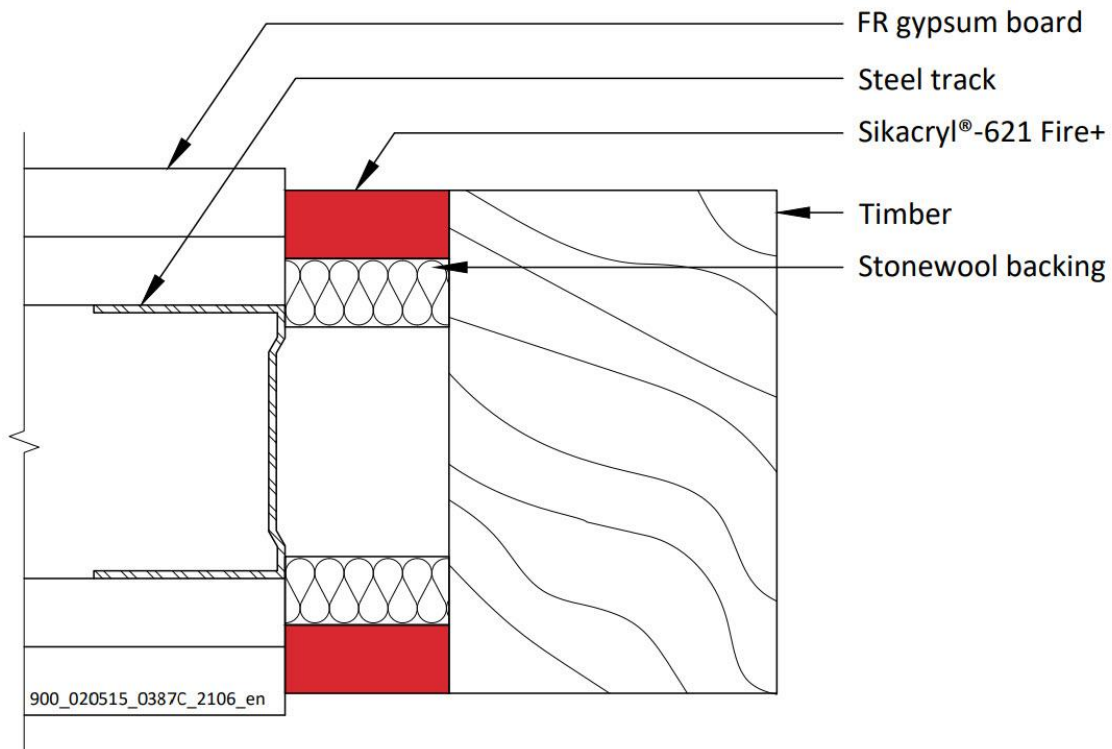

A.2.3.2

Substrate	Depth (mm)	Backing	Classification
Flexible or rigid wall / Timber	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m ³	E 90 – V – X – F – W 30
			EI 60 – V – X – F – W 30
			E 90 – T – X – F – W 30
			EI 60 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


18/27

A.2.4 Flexible or rigid wall construction with wall thickness of minimum 100 mm and steel substrates

A.2.4.1 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to one side of the wall, with joint widths up to 30 mm.

Construction details:

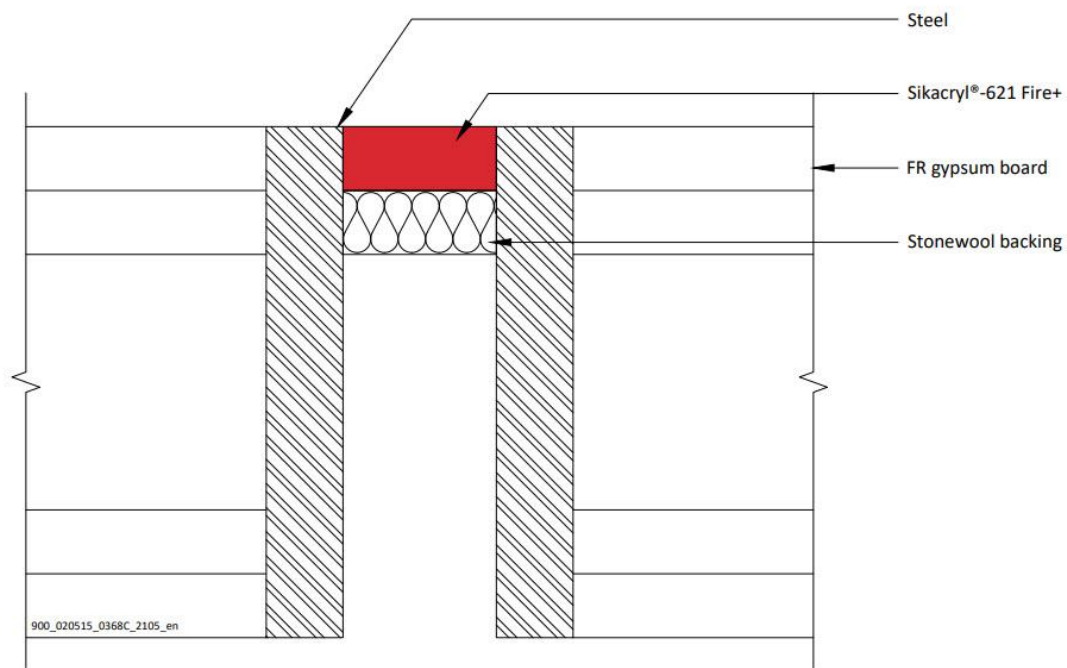

A.2.4.2

Substrate	Depth (mm)	Backing	Classification
Steel / steel	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m ³	E 120 – V – X – F – W 30
			EI 30 – V – X – F – W 30
			E 120 – T – X – F – W 30
			EI 30 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1


1549

19/27

A.2.5 Linear joint or gap seals, vertically or horizontal orientated with backing materials

Joint Seal: Sikacryl-621 Fire+ to both sides of the wall, with joint widths up to 30 mm.

Construction details:

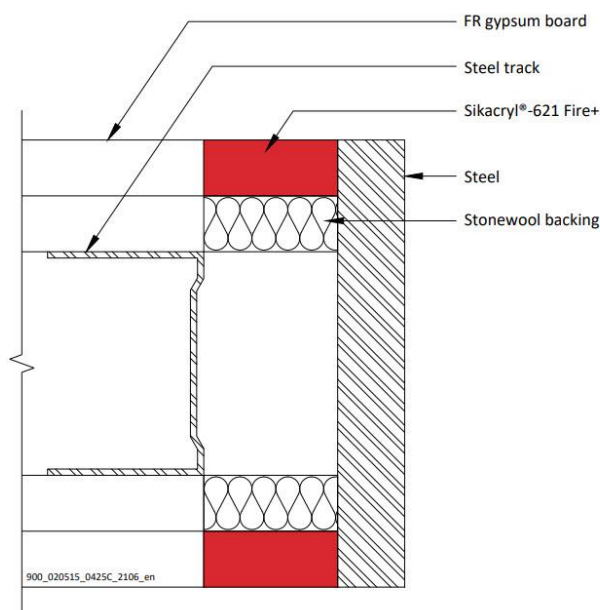

A.2.5.1

Substrate	Depth (mm)	Backing	Classification
Flexible or rigid wall / Steel	12.5 min.	Stonewool, 12.5 mm deep min. 35 kg/m ³	E 120 – V – X – F – W 30 ¹ EI 30 – V – X – F – W 30 ²
			E 120 – T – X – F – W 30 ³ EI 45 – T – X – F – W 30 ⁴

*Additional and for information only.

The classifications provided in Table A.2.5.1 consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

¹ 120, ² 90, ³ 120, ⁴ 60

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549




20/27

A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm

A.3.1 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls

Joint Seal: Sikacryl-621 Fire+ to either side (or any position between) or both sides of the wall, joint widths up to 30 mm

Construction details:

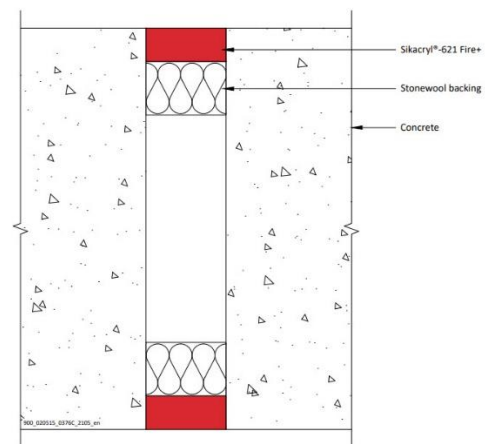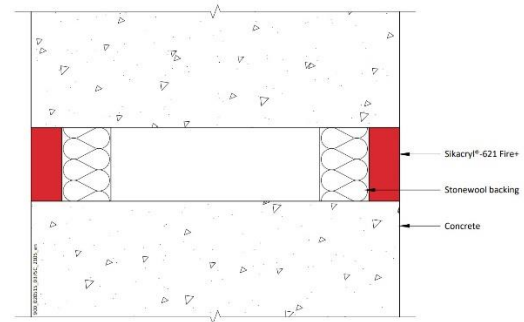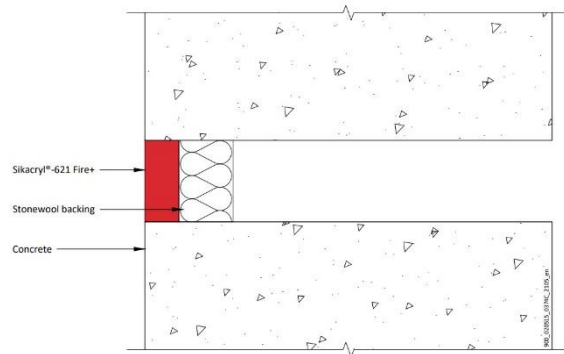

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549

21/27

A.3.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
masonry/ concrete	25 min. (one side)	20 mm Stone wool 40 kg/m ³	E 240 – T – X – F – W 30 EI 60 – T – X – F – W 30
	15 min. (both sides)		EI 240 – V – X – F – W 30 EI 240 – T – X – F – W 30
	10 min. (one side)	60 mm Stone wool 33 kg/m ³	E 240 – T – X – F – W 50 EI 60 – T – X – F – W 50 EI 120 – V – X – F – W 50
	25 min. (one side)	48 mm AES mineral fibre	E 240 – T – X – F – W 30 EI 120 – T – X – F – W 30

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549


22/27

A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm

A.4.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to the top face of the floor only

Joint Seal: Sikacryl-621 Fire+ to either side (or any position between) or both sides of the floor, joint widths up to 100 mm

Construction details:

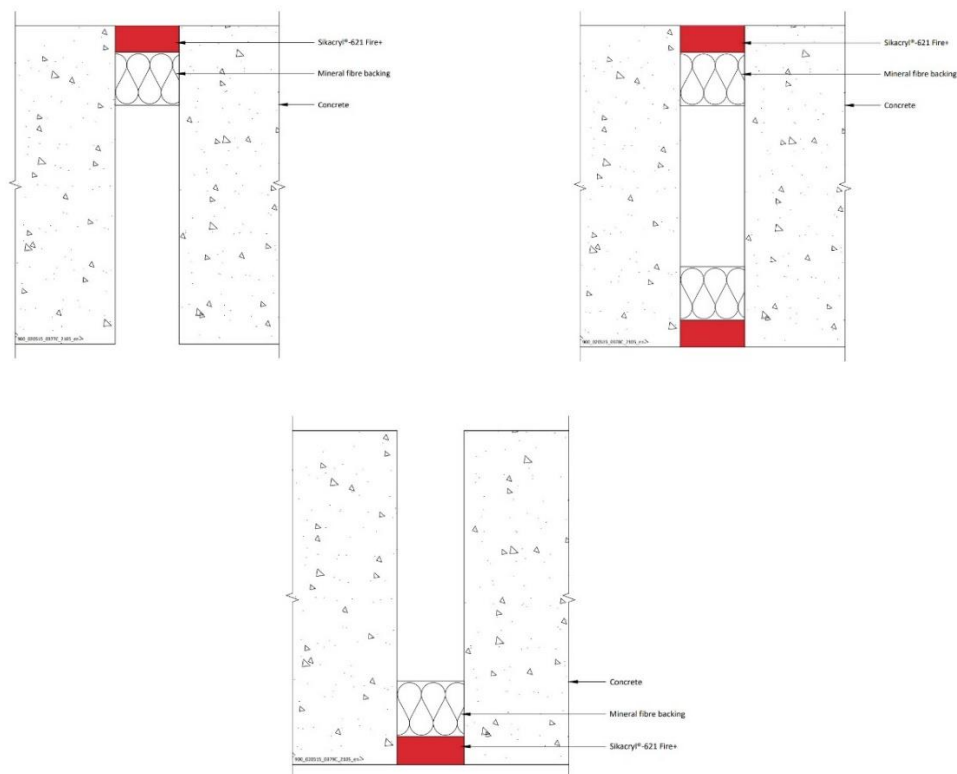

A.4.1.1

Substrate	Depth (mm)	Backing (minimum)	Classification
masonry/ concrete	25 min. (any position)	25 mm AES mineral fibre	E 120 – H – X – F – W 100
	25 min (top face)		EI 60 – H – X – F – W 100
	15 min. (both sides)	25 mm Stone wool 40 kg/m ³	EI 180 – H – X – F – W 100
		25 mm Stone wool 140 kg/m ³	EI 120 – H – X – F – W 100
	15 min. (both sides)	25 mm stone wool 35 kg/m ³ insulation	EI 180 – H – X – F – W 100
	10 min. (top face)	90 mm Stone wool 33 kg/m ³	EI 240 – H – X – F – W 30
			EI 240 – H – X – F – W 100

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1


1549

23/27

A.4.2 Linear joint or gap seals, in or between rigid floors

Joint Seal: Sikacryl-621 Fire+ in floor, joint widths up to 30 mm

Construction details:

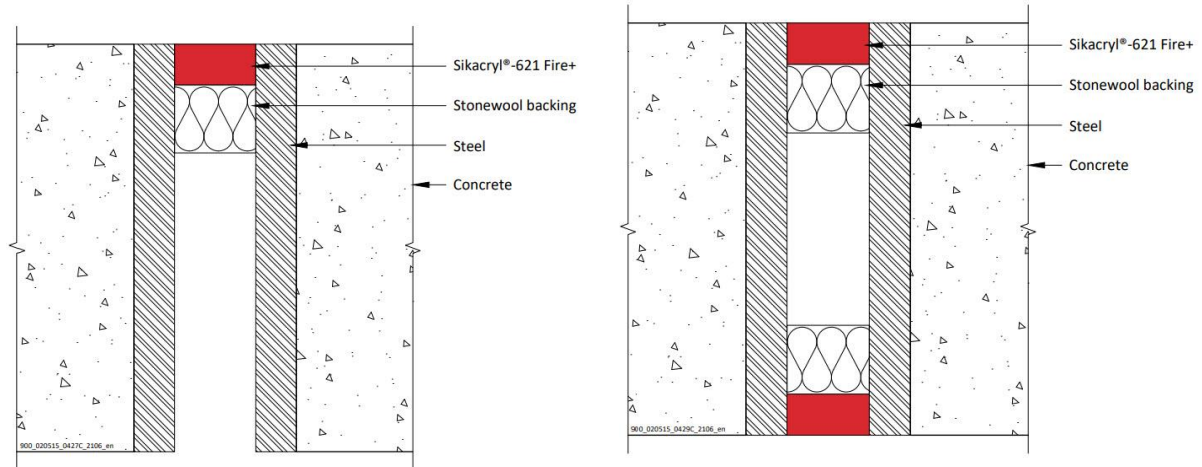

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549

24/27

A.4.2.1

Substrate	Depth (mm)	Backing	Position	Classification
Steel/ steel or Steel/ concrete	25 min.	Stonewool, 50 mm deep min. 35 kg/m ³	Top	E 240 – H – X – F – W 30 ¹ EI 30 – H – X – F – W 30 ²
	15 min.	Stonewool, 25 mm deep min. 35 kg/m ³	Both	E 240 – H – X – F – W 30 ³ EI 45 – H – X – F – W 30 ⁴
Aluminium / concrete	25 min.	Stonewool, 50 mm deep min. 35 kg/m ³	Top	E 180 – H – X – F – W 30 ⁵ EI 20 – H – X – F – W 30 ⁶

*Additional and for information only.

The classifications provided in Table A.4.2.1 consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

¹ 240, ² 60, ³ 240, ⁴ 120, ⁵ 180, ⁶ 60

EAD 350141-00-1106:2017
Notified Body 2531
Fire Stopping and Sealing Product: Linear Joint and Gap Seals

<http://dop.sika.com>

Declaration of Performance

Sikacryl 621 Fire+

79744211

2025.01 , ver. 1

1549

25/27

CE MARKING TO BE PLACED ON THE LABEL

 21
Sika Services AG, Zurich, Switzerland
79744211
For details see accompanying documents
EAD 350141-00-1106:2017
Notified Body 2531
Fire Stopping and Sealing Product: Linear Joint and Gap Seals

<http://dop.sika.com>

EKOLOGI, HÄLSA OCH SÄKERHETSINFORMATION (REACH)

För information och råd om säker hantering, lagring och avfallshantering av kemiska produkter, ska användarna konsultera det senaste säkerhetsdatabladet (SDB) innehållande fysiska, ekologiska, toxikologiska och annan säkerhetsrelaterad information.

LAGSTIFTNING

Informationen och i synnerhet rekommendationerna avseende applikation och slutanvändning av Sikaprodukterna lämnas i god tro baserat på Sikas nuvarande kunskap och erfarenhet av produkterna när dessa lagras, hanteras och används under normala förhållanden på ett korrekt sätt. I praktiken kan differenserna i material, underlag och den aktuella platsen variera på sådant sätt att ingen garanti vad gäller användbarhet eller lämplighet för ett visst ändamål kan lämnas. Med hänsyn härtill kan något rättsligt ansvar av vad slag det må vara varken härledas från denna information eller från någon skriftlig rekommendation eller i övrigt beträffande produkten lämnade råd. Hänsyn måste vid användningen även tas till tredje mans ägande och andra eventuella rättigheter. Alla order accepteras under förutsättningen av att Sikas aktuella försäljnings- och leveransbestämmelser är gällande. Användaren skall alltid använda sig av den senaste utgåvan av den aktuella produktens tekniska datablad, vilket kan erhållas vid förfrågan eller på hemsidan www.sika.se.

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

26/27

Sika Sverige AB
Domnarvsgatan 15
163 53 Spånga
Sverige
www.sika.se

Declaration of Performance

Sikacryl 621 Fire+
79744211
2025.01 , ver. 1
1549

27/27